
Series 4600F



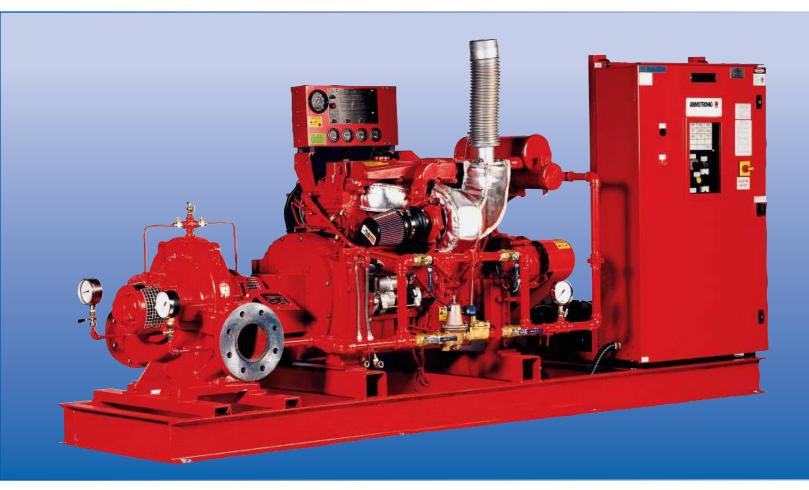

HSC Fire Pumps & Packaged Systems

FILE NO:	F43.11
DATE:	Sep. 25, 2011
SUPERSEDES:	F43.11
DATE:	May 26, 2008

Series 4600F - Truly Superior

The Series 4600F, drawing on over 100 years of pump design expertise and leadership, is the state of the art in Horizontal Split Case pumps. It meets or exceeds the requirements of NFPA and testing laboratories involved in fire protection such as UL, ULC & FM.

The family of pumps capitalize on the "Tilted Parting" concept to minimize turbulence at the eye of the impeller

Recirculation

• External Water Seal Recirculation Lines

2 Couplina

• UL Listed close-coupled coupling

Stuffing Box Housing

- Self contained Combination Bearing & Seal Housing
- Permits packing change-out without having to be removed

4 Drip Containment

Fitted with drain connection

6 Casing Wear Ring

- Replaceable Case Wear Rings
- Locked to prevent rotation or axial displacement
- Impeller Wear Ring available as an option

6 Pump Casing

 Designed to withstand the high pressure requirement typical in fire protection

Impeller

- Hydraulically balanced double suction
- Dynamically balanced
- Minimum axial thrust
- High efficiency throughout operating range

B Shaft Sealing with Packing

- Three-piece Split Gland standard
- Packing replaceable without disturbing wetted parts
- Stuffing Box Extension designed for easy access

Shaft Sleeves

- Replaceable bronze sleeves
- Protects shaft throughout Stuffing Box

D Bearings

- Easy removal with bearing nut
- Sealed, permanently greased bearings
- Low Friction Lost Bearing
- Maintenance free

Bearing Housing

Removable without removing top casing


D Shaft


- Minimum deflection for long bearing life
- Minimum vibrations
- Identical shaft and parts for left and right-hand drives



The pumps' compact sizes are ideally suited for space saving packages and retrofit applications.



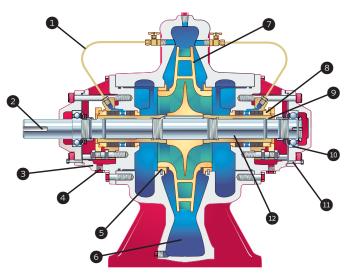



CASING

Suction and Discharge on same center line

Tilted Parting Design Casing

- · Permits laminar approach to eye of Impeller
- Lower NPSH required
- Lower pump profile
- Minimum pump footprint
- Removeable rotating element without disturbing piping
- Low foot-mounted Casing to reduce vibrations

HSC Fire Pumps & Packaged Systems

Horizontal Fire Systems

With years of experience in fire protection industry, Armstrong can supply fire pump systems with all necessary accessories ready for site installation.

GUARANTEED ADVANTAGES

- Simplifies piping design
- Single source unit responsibility
- A complete package that will meet NFPA-20 requirements

FIRE PUMP - ELECTRIC DRIVEN

- 1. Pump/motor
- 2. Fire pump controller (with optional transfer switch)
- 3. Suction and discharge gauges
- 4. Air release valve
- 5. Casing relief valve (not shown)
- 6. Jockey pump
- 7. Common base

FIRE PUMP - DIESEL ENGINE DRIVEN

- 1. Pump/engine assembled with
 - Cooling system
 - Fuel system
 - Battery system
 - Exhaust system
- 2. Fire pump controller
- 3. Suction and discharge gauges
- 4. Air release valve

250

200

150

100

50

500

750

Rated Capacity (USGPM)

1000

1250

Rated Head (psi)

- JOCKEY CONTROLLER FUEL FIRE PUMP TANK 8 CONTROLLER 12 10 6 7
- 6. Jockey pump
- 7. Common base

ACCESSORIES - ADDITIONAL (ELECTRIC OR DIESEL)


- 8. Suction OS&Y gate valve
- 9. Discharge butterfly valve
- 10. Check valve
- 11. Test tee

ACCESSORIES - SPECIAL FOR DIESEL OR VFD

- 12. Main relief valve
- 13. Enclosed cone (not shown)



Fire Pump Coverage Chart Electrical 60 Hz




1000

750

500

275

Electrical 50 Hz

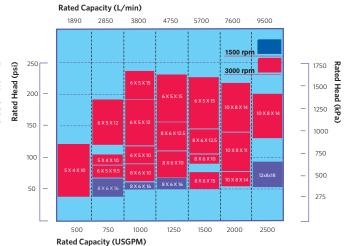

Rated Capacity (L/min) 1890 2850 3800 4750 5700

1500

2000

2500

3000

7600

9500

1800 rpm

3600 rpi

11400

Typical Specifications

Horizontal Fire Pump - Electric Motor Driven*

Supply and install as indicated on plans one (1) fire pump system consisting of:

1. FIRE PUMP

One Armstrong, Series 4600F, Size ______ double suction horizontal split case fire pump listed by [Underwriters Laboratories of Canada (ULC)], [Underwriters Laboratories Inc. (UL)] and/or [approved by Factory Mutual (FM)] having a capacity of ______ Usgpm for a pressure boost of ______ PSIG. Suction pressure _____ PSIG.

Pump casing shall be of cast iron, axially split with a 15° angle that will minimize npsh requirements and dimensions. Lower half shall contain suction and discharge nozzles. Suction and discharge connections shall be on the same elevation. Top half and rotating element shall be removable without disturbing the piping. Casing shall be fitted with replaceable bronze wearing rings. Impeller shall be bronze, double suction, enclosed type fully balanced and keyed to an alloy steel shaft. Shaft shall to be fitted with replaceable bronze sleeves. Shaft shall be mounted in two dust tight deep grooves, sealed, and permanently greased ball bearings.

Bearings shall be mounted in cartridge type housing so that they shall be replaceable without opening pump casing. Bearings shall be easily removable by rotating bearing removal nut. No special tools or bearing puller are to be necessary.

Each stuffing box shall be fitted with a three piece bronze gland. Stuffing box shall be fitted with a stuffing box extension to facilitate the packing rings removal. Packing rings shall be removable without disturbing wetted parts or the pump bearings. Water seal recirculation lines made from noncorroding material shall be piped to pump volute.

2. ELECTRIC MOTOR

3. MINIMUM FITTINGS

The pump shall be supplied with the following accessories:

- One (1) combination suction gauge $3^{1}\!\!\!/ 2^{\prime\prime}$ dial type with $^{1}\!\!/ 4^{\prime\prime}$ cock and lever handle.
- One (1) discharge gauge, $3\frac{1}{2}$ " dial type, with $\frac{1}{4}$ " cock and lever handle.
- One (1) air release valve.
- One (1) casing pressure relief valve.

4. OTHER ACCESSORIES

Pump shall be fitted with one (1) eccentric suction reducer and one (1) concentric discharge increaser, as required (by mechanical contractor) to fit NFPA 20 recommended piping sizes.

One (1) outside test header shall be supplied with one (1) set of $___ x 2\frac{1}{2}$ " hose valves with caps and chains.

F 716-693-8970

5. FIRE PUMP CONTROLLER

The fire pump controller shall be specifically approved for fire pump service by [ULC], [UL] and/or [FM]. The controller shall be of the combined manual and automatic stop, ______starting method, Model ______ as manufactured by______. All equipment shall be enclosed in an approved drip proof enclosure. The control equipment shall be completely assembled, wired and tested at point of manufacture prior to shipment.

Circuit breaker shall have an interrupting capacity of _____kAmps or a withstand rating of _____kAmps RMS.

Water pressure switch shall be suitable for _____ PSI working pressure.

5A. FIRE PUMP CONTROLLER AND AUTOMATIC TRANSFER SWITCH COMBINATION

The automatic transfer switch controller combination shall be approved by [UL], [ULC] and/or [FM], Model ______ as manufactured by______. The automatic transfer switch and the pump controller shall each be mounted in separate enclosures, mechanically attached to form one unit and provide for protected interlock wiring.

The automatic transfer switch shall be capable of automatic power transfer from normal to alternate_____ [generator] / [second utility] emergency power source in case of normal supply failure and automatically re-transfer after restoration of normal power conditions.

6. JOCKEY PUMP

The jockey pump shall be manufactured by ______ Model ______ for a capacity of ______ Usgpm and a pressure boost of ______ PSIG. The jockey pump shall be driven by an [open drip proof] [totally enclosed fan cooled] electric motor of ______ HP, _____ RPM _____ VOLT _____ PHASE _____ CYCLE

7. JOCKEY PUMP CONTROLLER

The jockey pump shall be controlled by an automatic jockey pump controller model_____ as manufactured by ______with full voltage starter.

8. MOUNTING AND TESTING

The fire pump shall be suitable for a maximum working pressure of ______. The fire pump shall be hydrostatically tested at twice the maximum working pressure for at least 5 minutes. The fire pump shall be performance tested at rated speed. The fire pump shall furnish not less than 150% of rated capacity at a pressure not less than 65% of rated head. The shut-off total head of the fire pump should not exceed 140% of total rated head. A certified test curve, indicating the flow, head, power and efficiency shall be supplied for the field acceptance test. The fire pump and electric motor shall be base mounted and aligned at the pump manufacturer's factory. Final alignment shall be made after installation on site

* Please refer to Armstrong Fire Pump Catalogue for Diesel Driven Typical Specifications

S. A. ARMSTRONG LIMITED

23 Bertrand Avenue Toronto, Ontario Canada, M1L 2P3 T 416-755-2291 F 416-759-9101 ARMSTRONG PUMPS INC. 93 East Avenue North Tonawanda, New York U.S.A., 14120-6594 T 716-693-8813

ARMSTRONG INTEGRATED LIMITED

Wenlock Way Manchester United Kingdom, M12 5JL T +44 (0) 8444 145 145 F +44 (0) 8444 145 146



[©] S.A. ARMSTRONG LIMITED 2011

For Armstrong locations worldwide, please visit www.armstrongintegrated.com